


# Skaneateles Lake Water Service Illustration

Illustration is not to scale

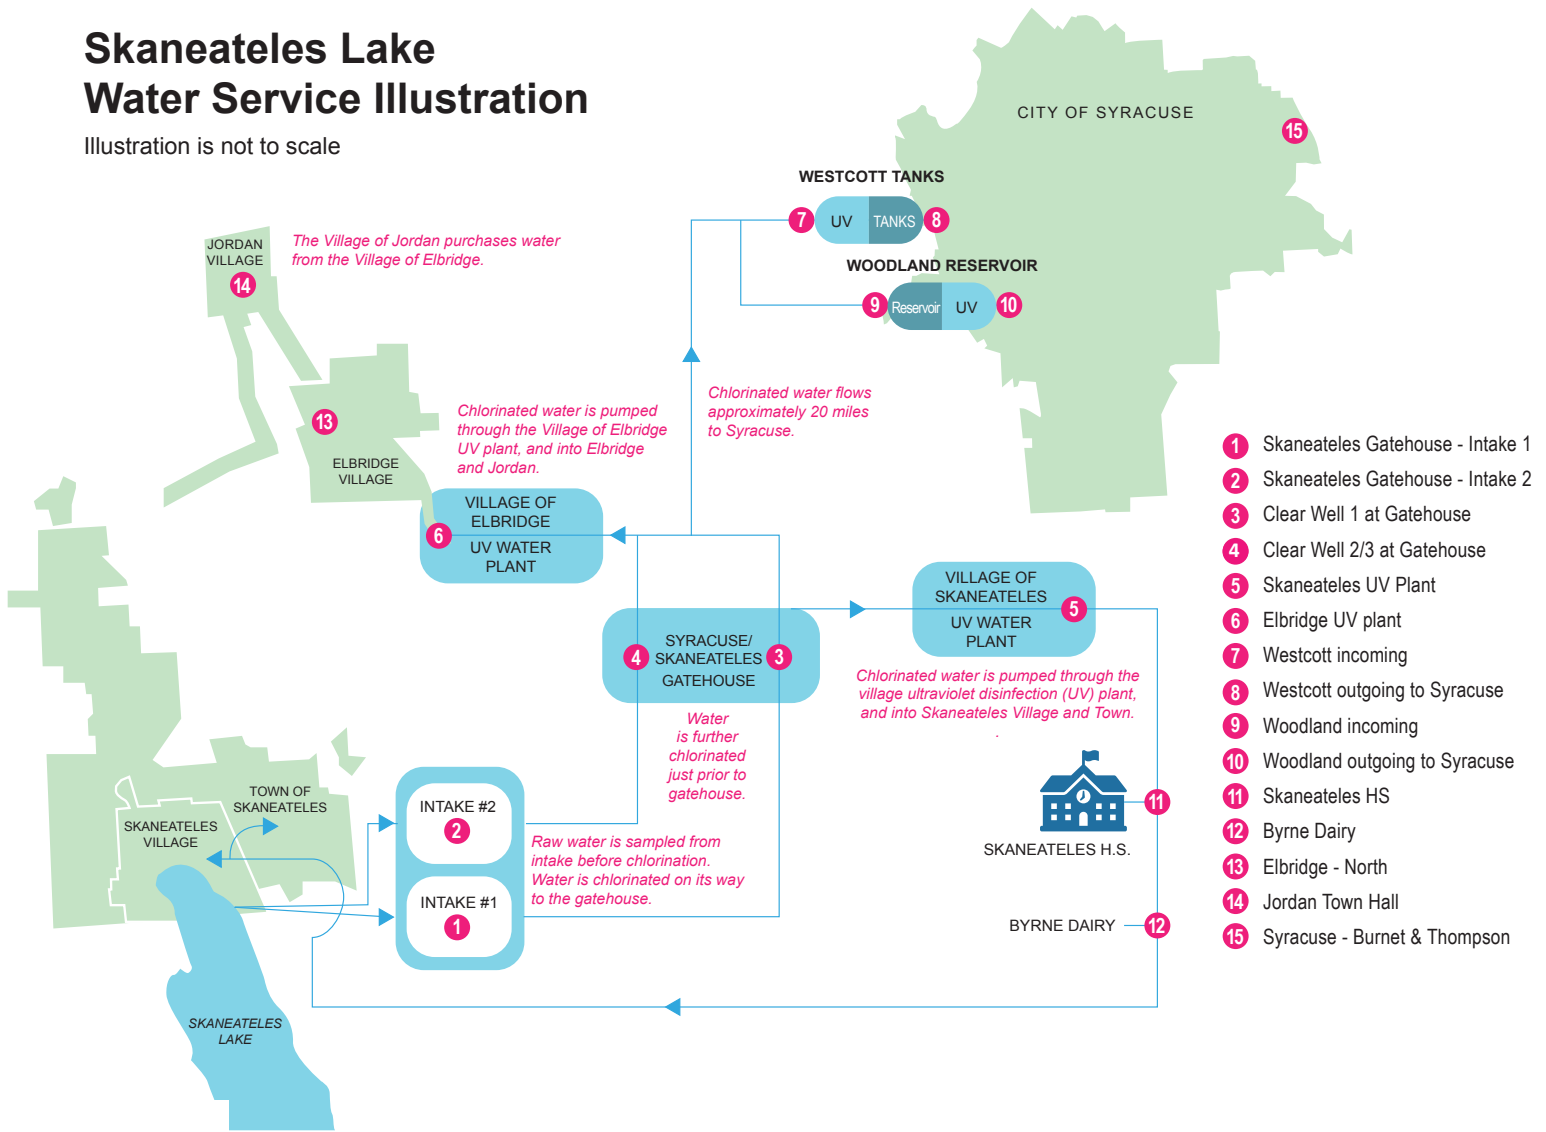

## DATE SAMPLED

SAMPLE	10-1	9-30	9-29	9-28	9-27	9-26	9-25	9-24	9-23	9-22	9-21	9-20	9-19	9-18
<b>1</b> Skaneateles Gatehouse - Intake 1	0.20	0.53	ND	ND	0.31	0.25	0.77	0.34	ND	0.19	0.26	0.44	0.49	0.32
<b>2</b> Skaneateles Gatehouse - Intake 2	0.33	0.77	ND	ND	0.65	0.56	0.40	0.46	ND	0.22	0.2	0.28	0.62	0.26
<b>3</b> Clear Well 1 at Gatehouse	ND	ND	ND	ND	ND	ND	ND	ND	-	-	ND	ND	ND	-
<b>4</b> Clear Well 2/3 at Gatehouse	0.16	0.16	ND	ND	ND	ND	ND	ND	ND	ND	0.19	0.25	0.26	0.26
<b>5</b> Skaneateles UV Plant	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	-
<b>6</b> Elbridge UV plant	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	-
<b>7</b> Westcott incoming	-	-	-	-	-	-	-	-	-	-	ND	ND	ND	-
<b>8</b> Westcott outgoing to Syracuse	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	-	ND	ND	-
<b>9</b> Woodland incoming	-	-	-	-	-	-	-	-	-	-	ND	ND	ND	-
<b>10</b> Woodland outgoing to Syracuse	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	-	ND	ND	-
<b>11</b> Skaneateles HS	-	-	-	-	-	-	-	-	-	-	ND	ND	ND	-
<b>12</b> Byrne Dairy	-	-	-	-	-	-	-	-	-	-	ND	ND	ND	-
<b>13</b> Elbridge - North	-	-	-	-	-	-	-	-	-	-	-	ND	ND	-
<b>14</b> Jordan Town Hall	-	-	-	-	-	-	-	-	-	-	-	ND	ND	-
<b>15</b> Syracuse - Burnet & Thompson	-	-	-	-	-	-	-	-	-	-	-	ND	ND	-

Values in parts per billion (ppb)

ND = Non Detect

"-" = Not Sampled